


Note:  
Conduit, drain tubes and cap  
may be galvanized steel or PVC.

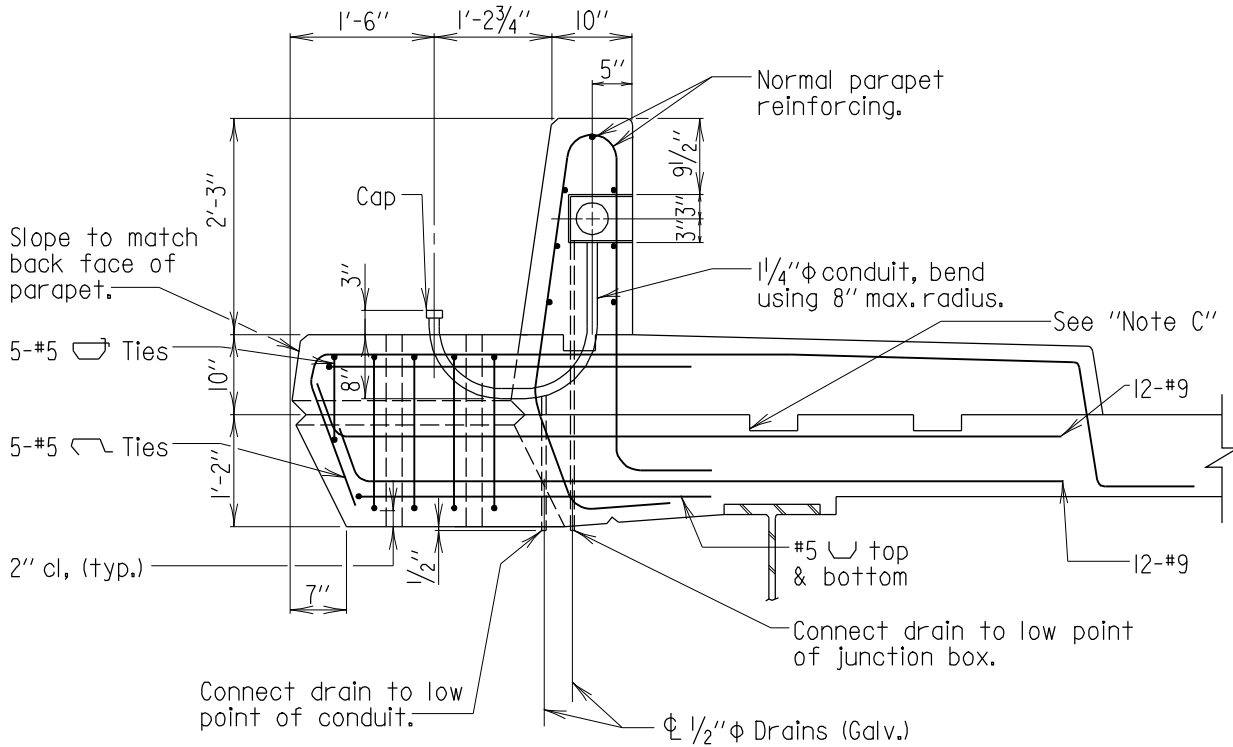

### SECTION B-B FOR SIDEWALKS WITH PARAPET

Scale: 1/2" = 1'-0"

Note:

All longitudinal bars are #5's and shall be placed continuously in the sidewalk from expansion opening to expansion opening in a simple span bridge and expansion opening to centerline of pier in a multispan bridge. Refer to BR-SS(6.26)-03-161.

Note C:

The constr. jt. between the sidewalk and the deck slab may vary slightly from the joint indicated.

For exact details and location of the joint see "Superstructure" Sheet.

## SIDEWALK WITH DIAMOND BACK

APPROVAL	
<i>E. S. Friedman</i>	DIRECTOR
OFFICE OF BRIDGE DEVEL.	
DATE: 6/1/05	
REVISIONS	
SHA	FHWA
.	.
.	.
.	.

FHWA APPROVAL  
DATE: 3-19-85

STATE OF MARYLAND  
DEPARTMENT OF TRANSPORTATION  
STATE HIGHWAY ADMINISTRATION  
OFFICE OF BRIDGE DEVELOPMENT

SUPPORT BRACKET FOR MOUNTED LIGHT POST  
WITH SINGLE CONDUIT AND PARAPET  
WITH DIAMOND BACK AND SIDEWALK

STANDARD NO. BR-SS(6.53)-05-355

SHEET 2 OF 2

SUPER-CONCRETE WORK